



ESSEX COUNTY

OFFICE OF THE MANAGER

7551 Court Street · P.O. Box 217 · Elizabethtown, New York 12932
Telephone (518) 873-3332 · Fax (518) 873-3339

Daniel L. Palmer
County Manager

Linda M. Wolf
Purchasing Agent

TO: All Bidders

FROM: Linda Wolf, CPA, Purchasing Agent

DATE: January 19, 2018

SUBJECT: Addendum #1 ANGIER HILL DC POWER SYSTEM INSTALLATION

This Addendum, issued to bid document holders of record, indicates changes to the bid documents for the *Angier Hill DC Power System Installation* Bid Opening January 26, 2018.

Please see the attached photographs of site.


END OF ADDENDUM # 1










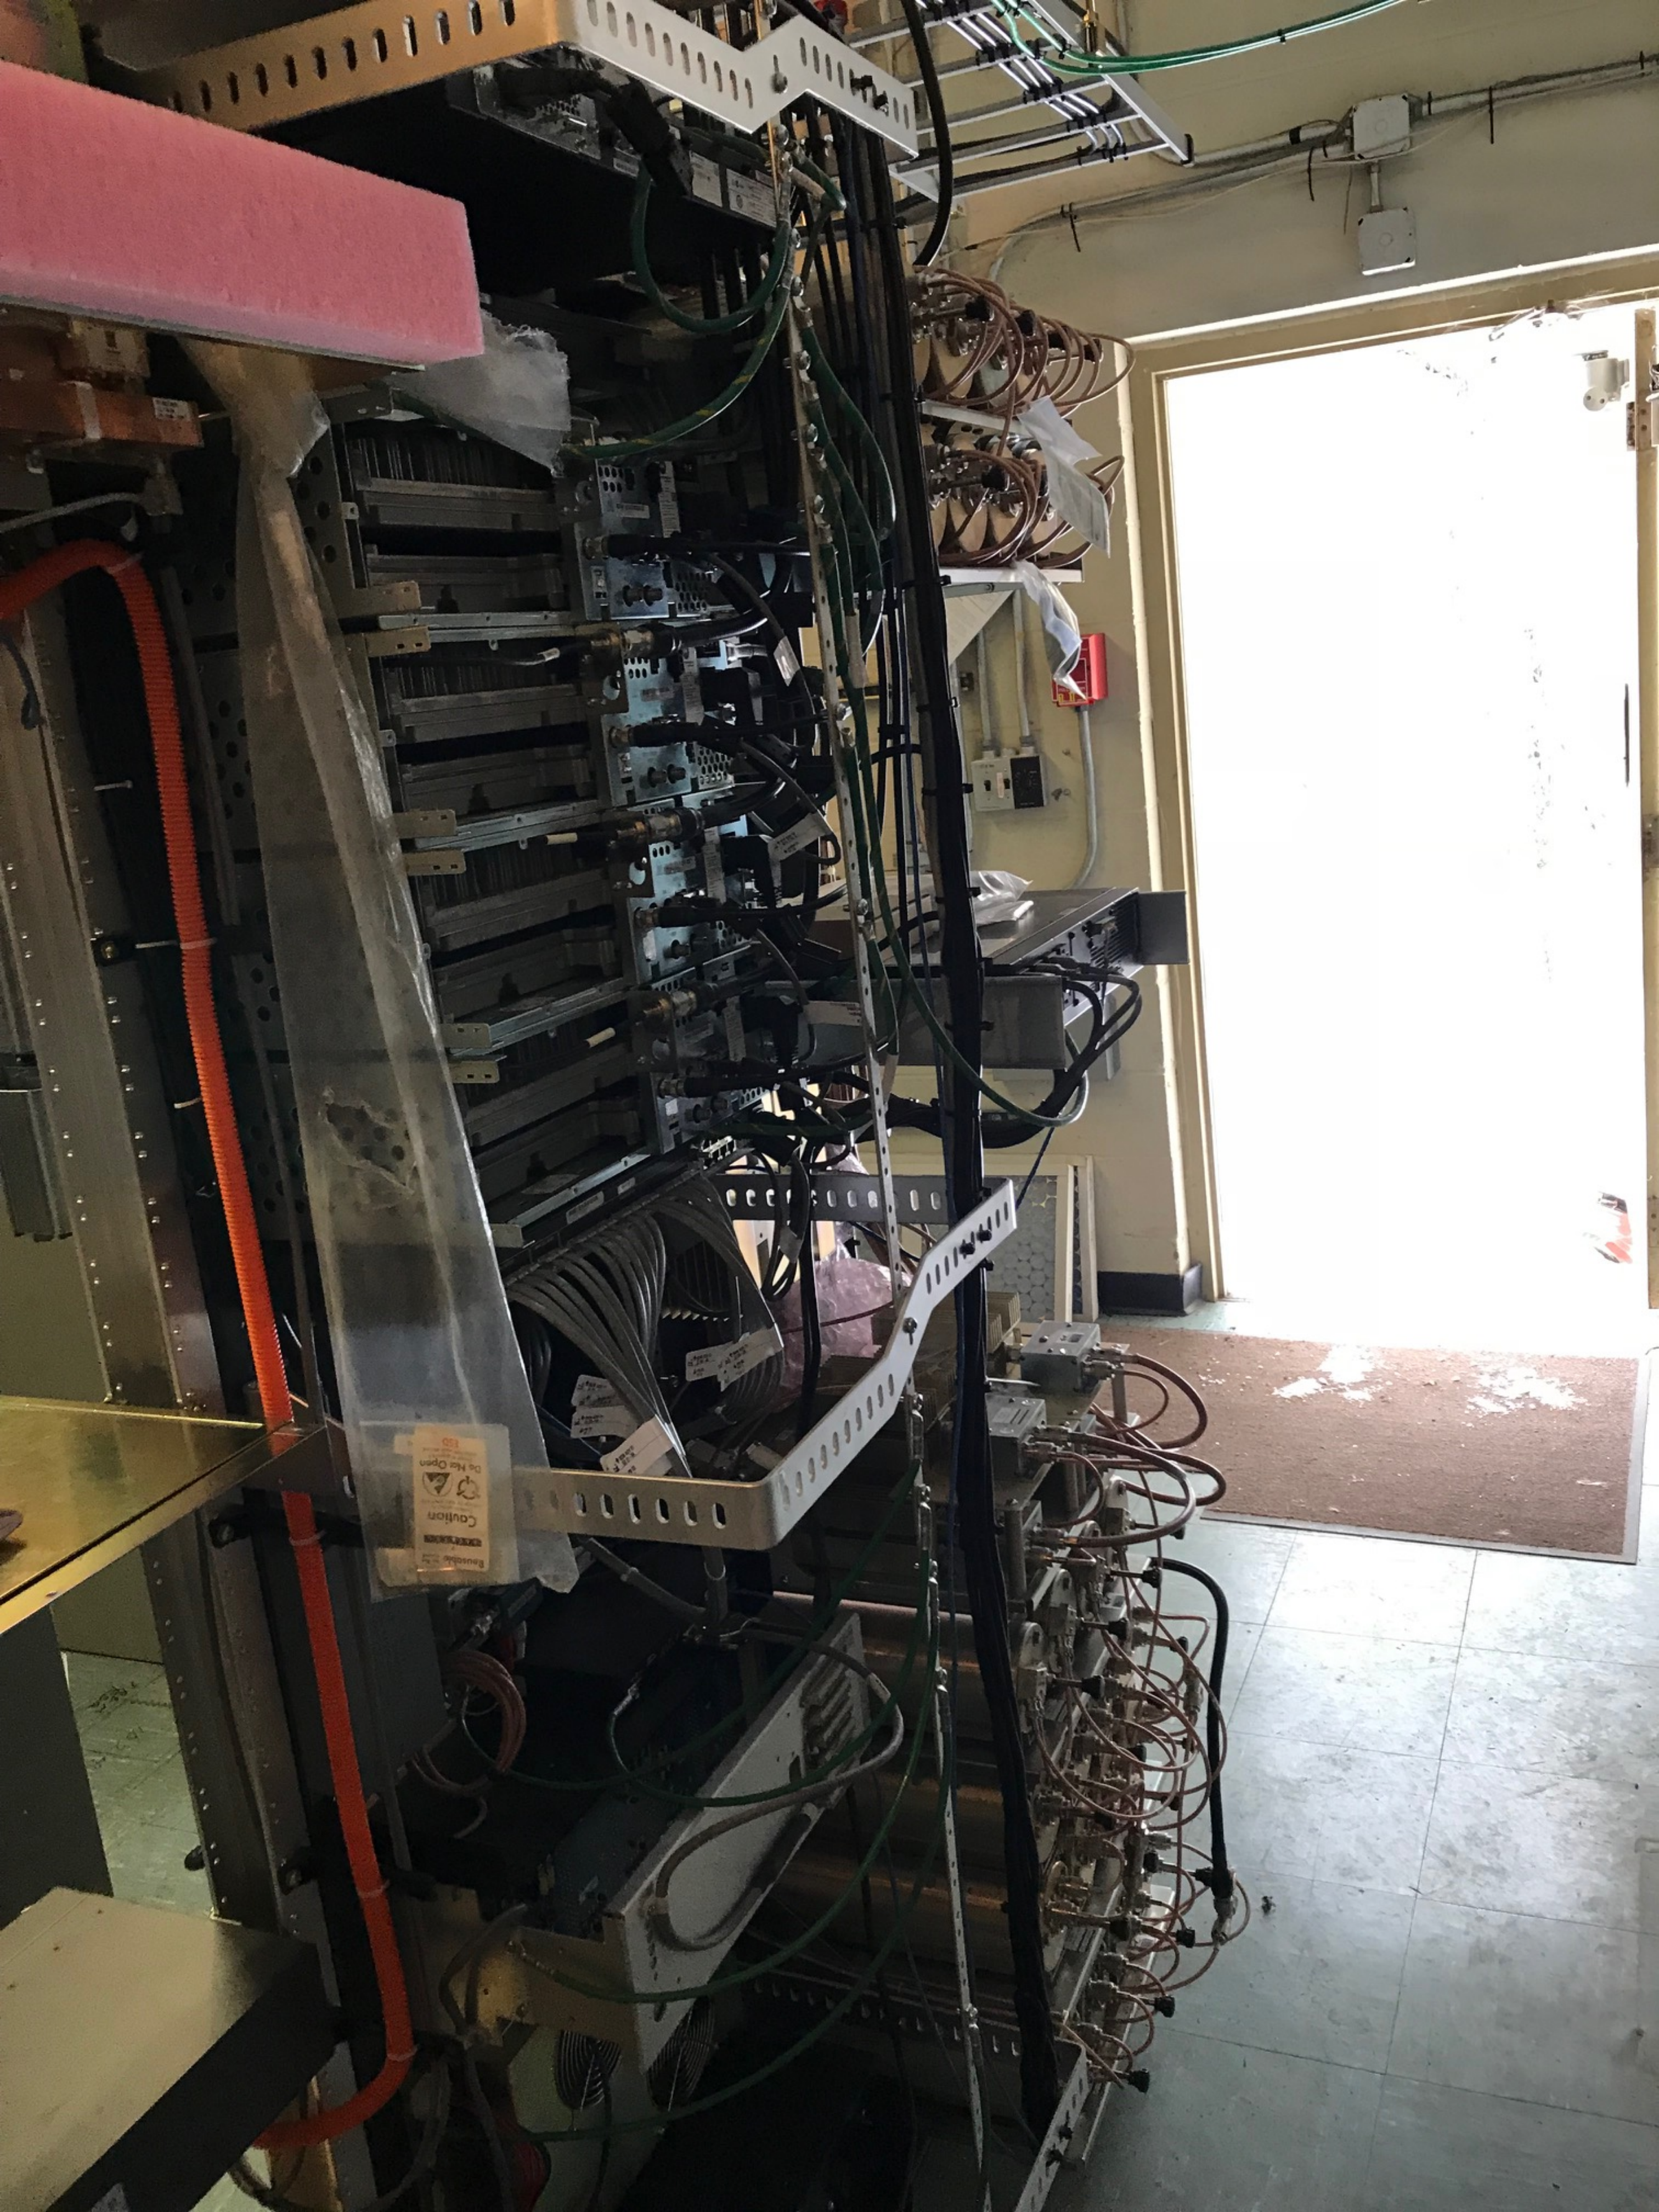



SERVICE
POWER SY
-6567

LER.
VER SYST

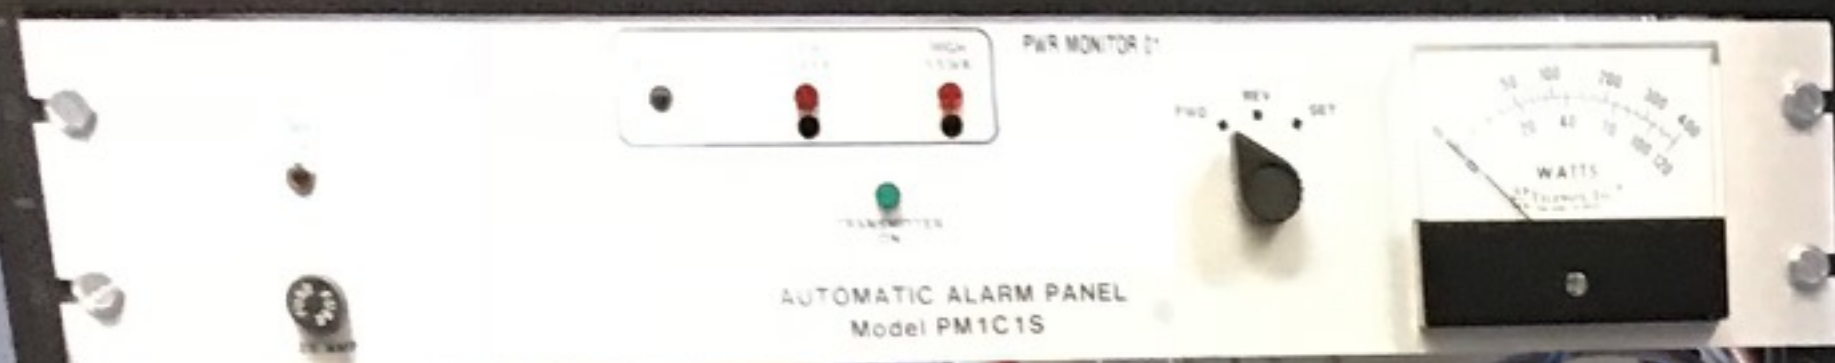



EATON

ON

OFF

EATON

FerriUPS

Model: 1500VA/1000W

Input Voltage: 120VAC

Output Voltage: 120VAC

Input Amperage: 12.5A

Output Amperage: 8.3A

Battery: 48VDC

Runtime: 10min