



ESSEX COUNTY

OFFICE OF THE MANAGER

7551 Court Street · P.O. Box 217 · Elizabethtown, New York 12932
Telephone (518) 873-3332 · Fax (518) 873-3339

Daniel L. Palmer
County Manager

Linda M. Wolf
Purchasing Agent

TO: All Bidders

FROM: Linda Wolf, CPA, Purchasing Agent

DATE: July 18, 2018





SUBJECT: Addendum #2 DPW BOILER BREECHING

This Addendum, issued to bid document holders of record, indicates changes to the bid documents for the *DPW Boiler Breeching Bid Opening July 25, 2018.*

The demolition scope has changed. Essex County will remove the free standing stack outside of the boiler room wall. The demolition of the rest of the breeching from the stack through the wall to the boilers is the responsibility of the contractor.

Attached is a marked drawing for your reference.

END OF ADDENDUM # 2

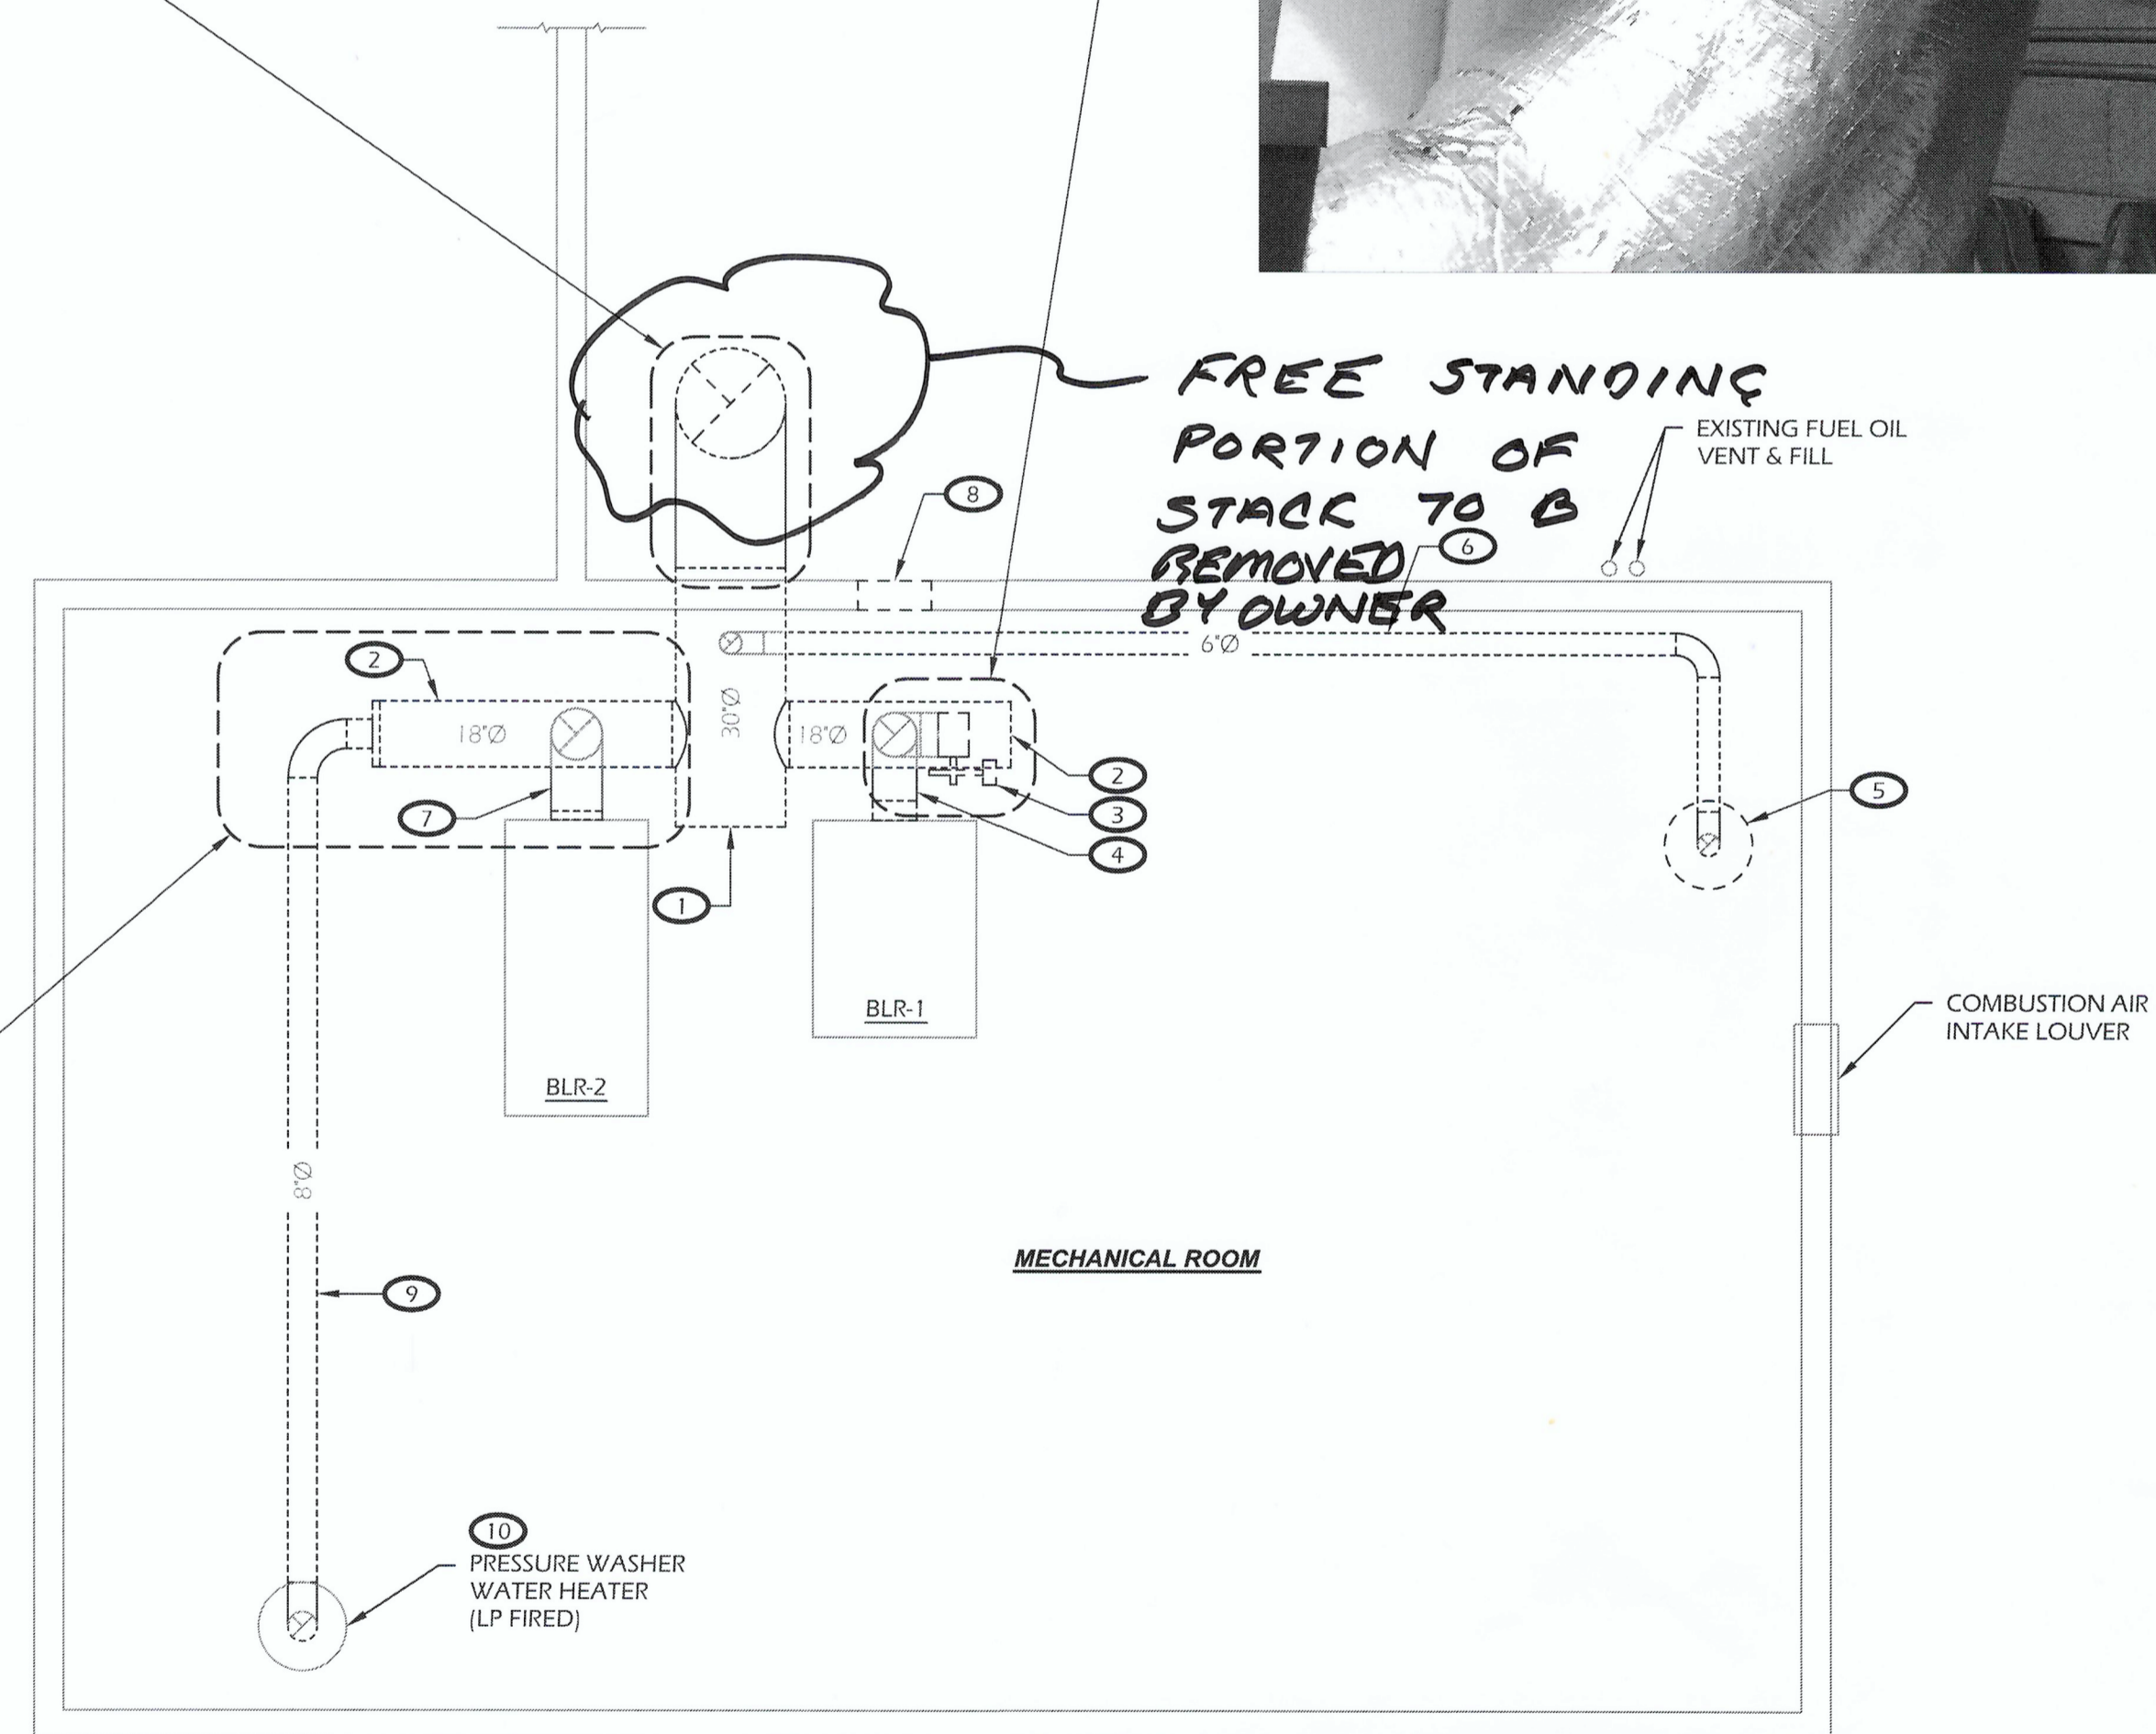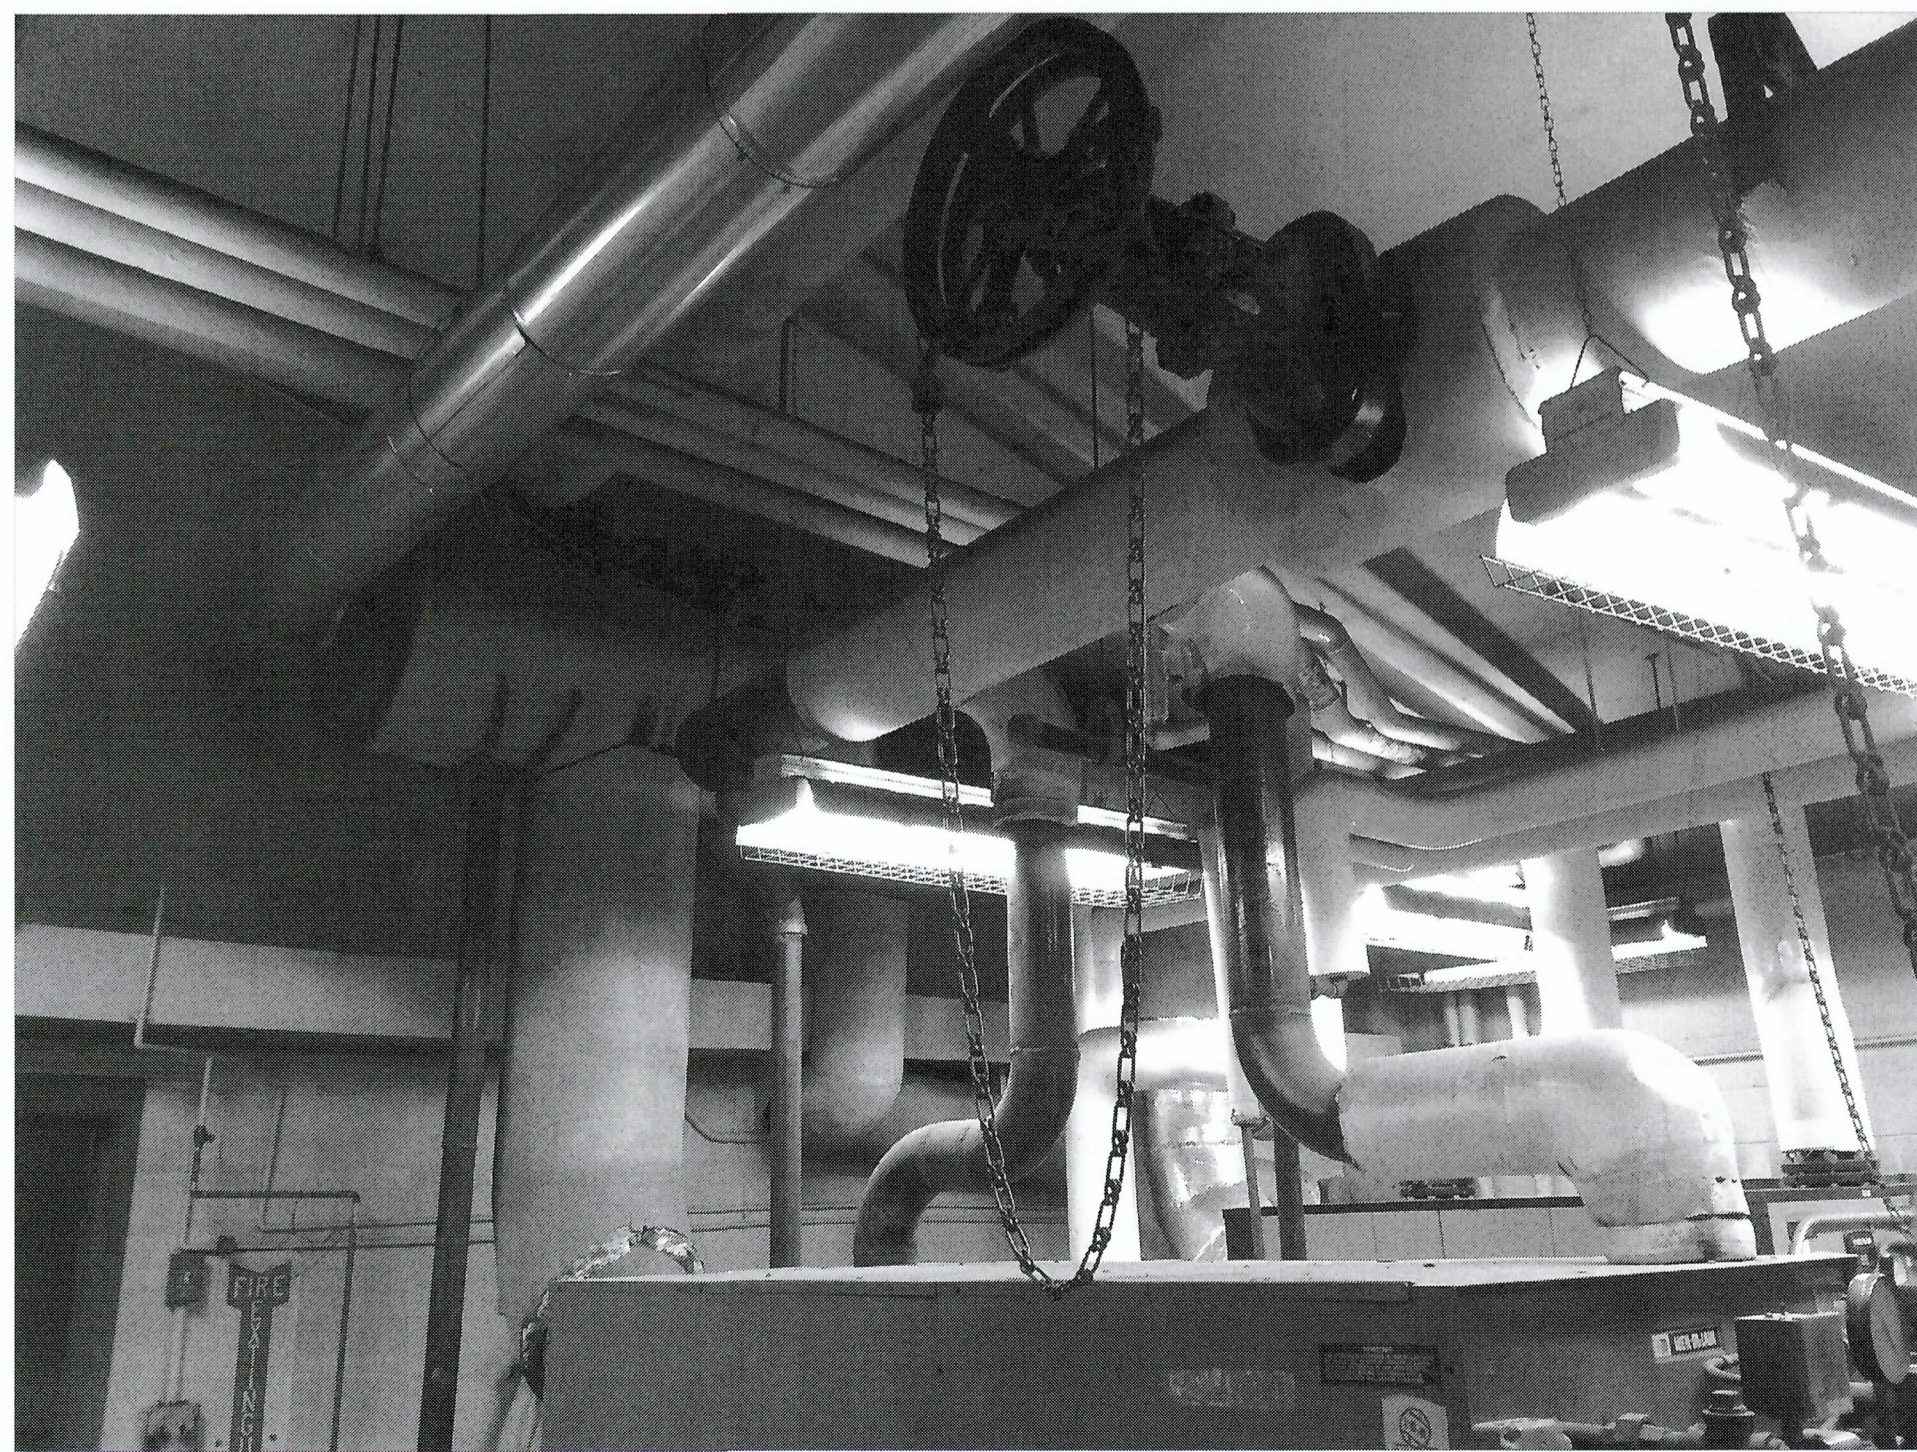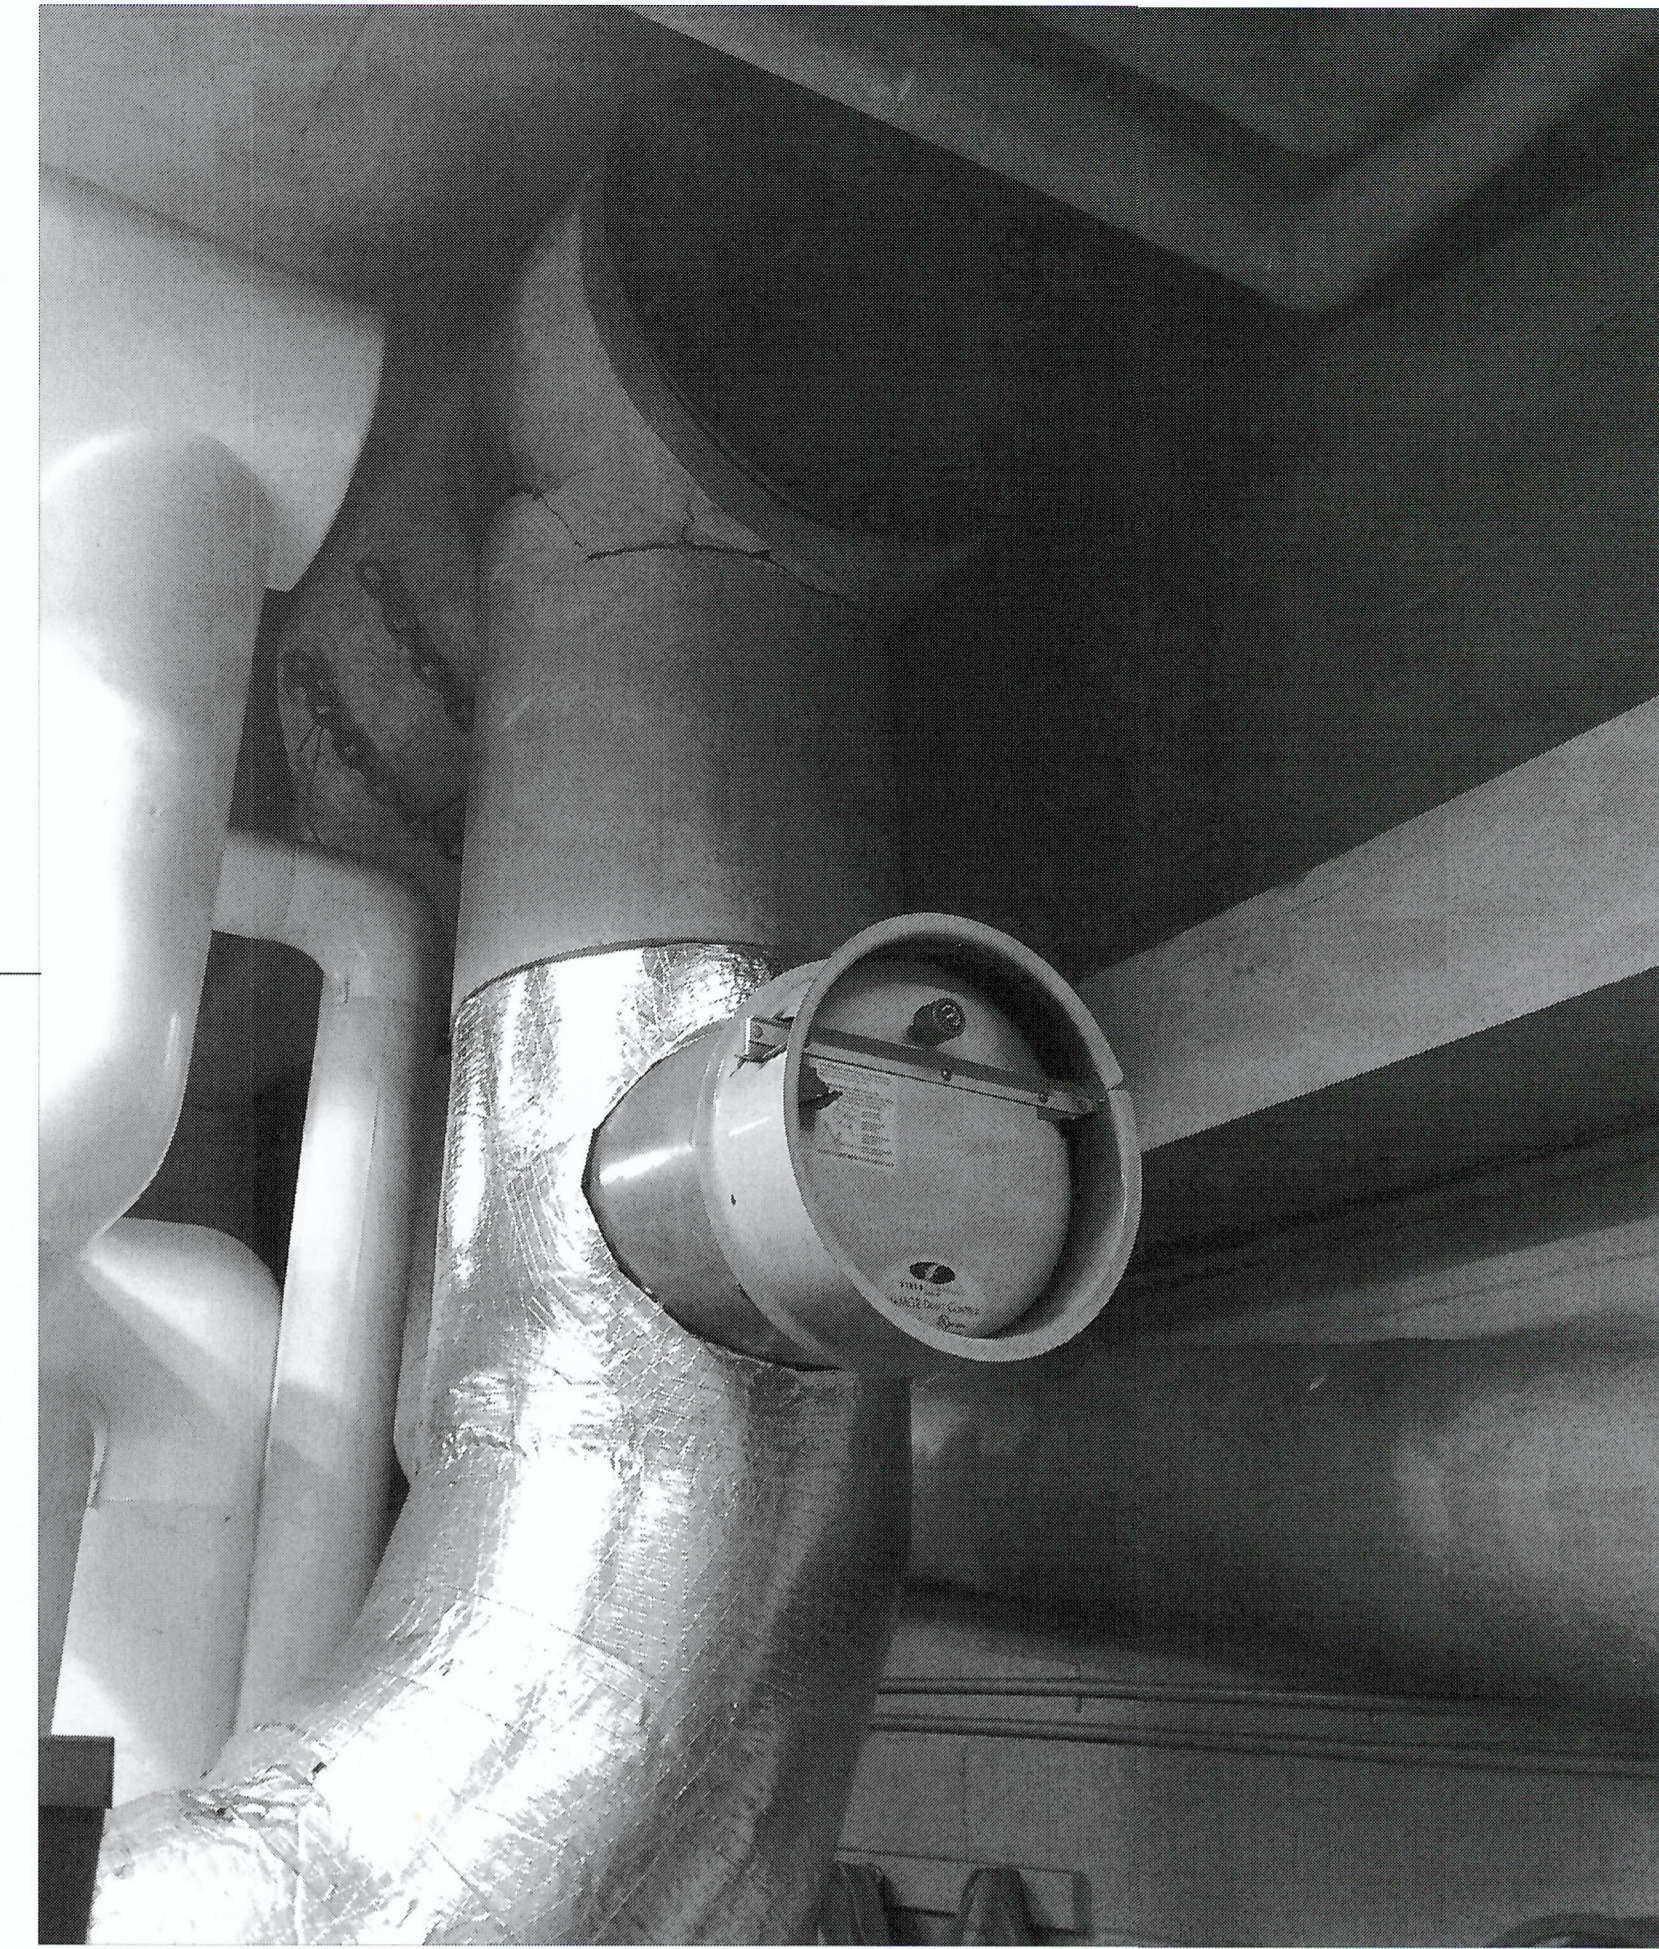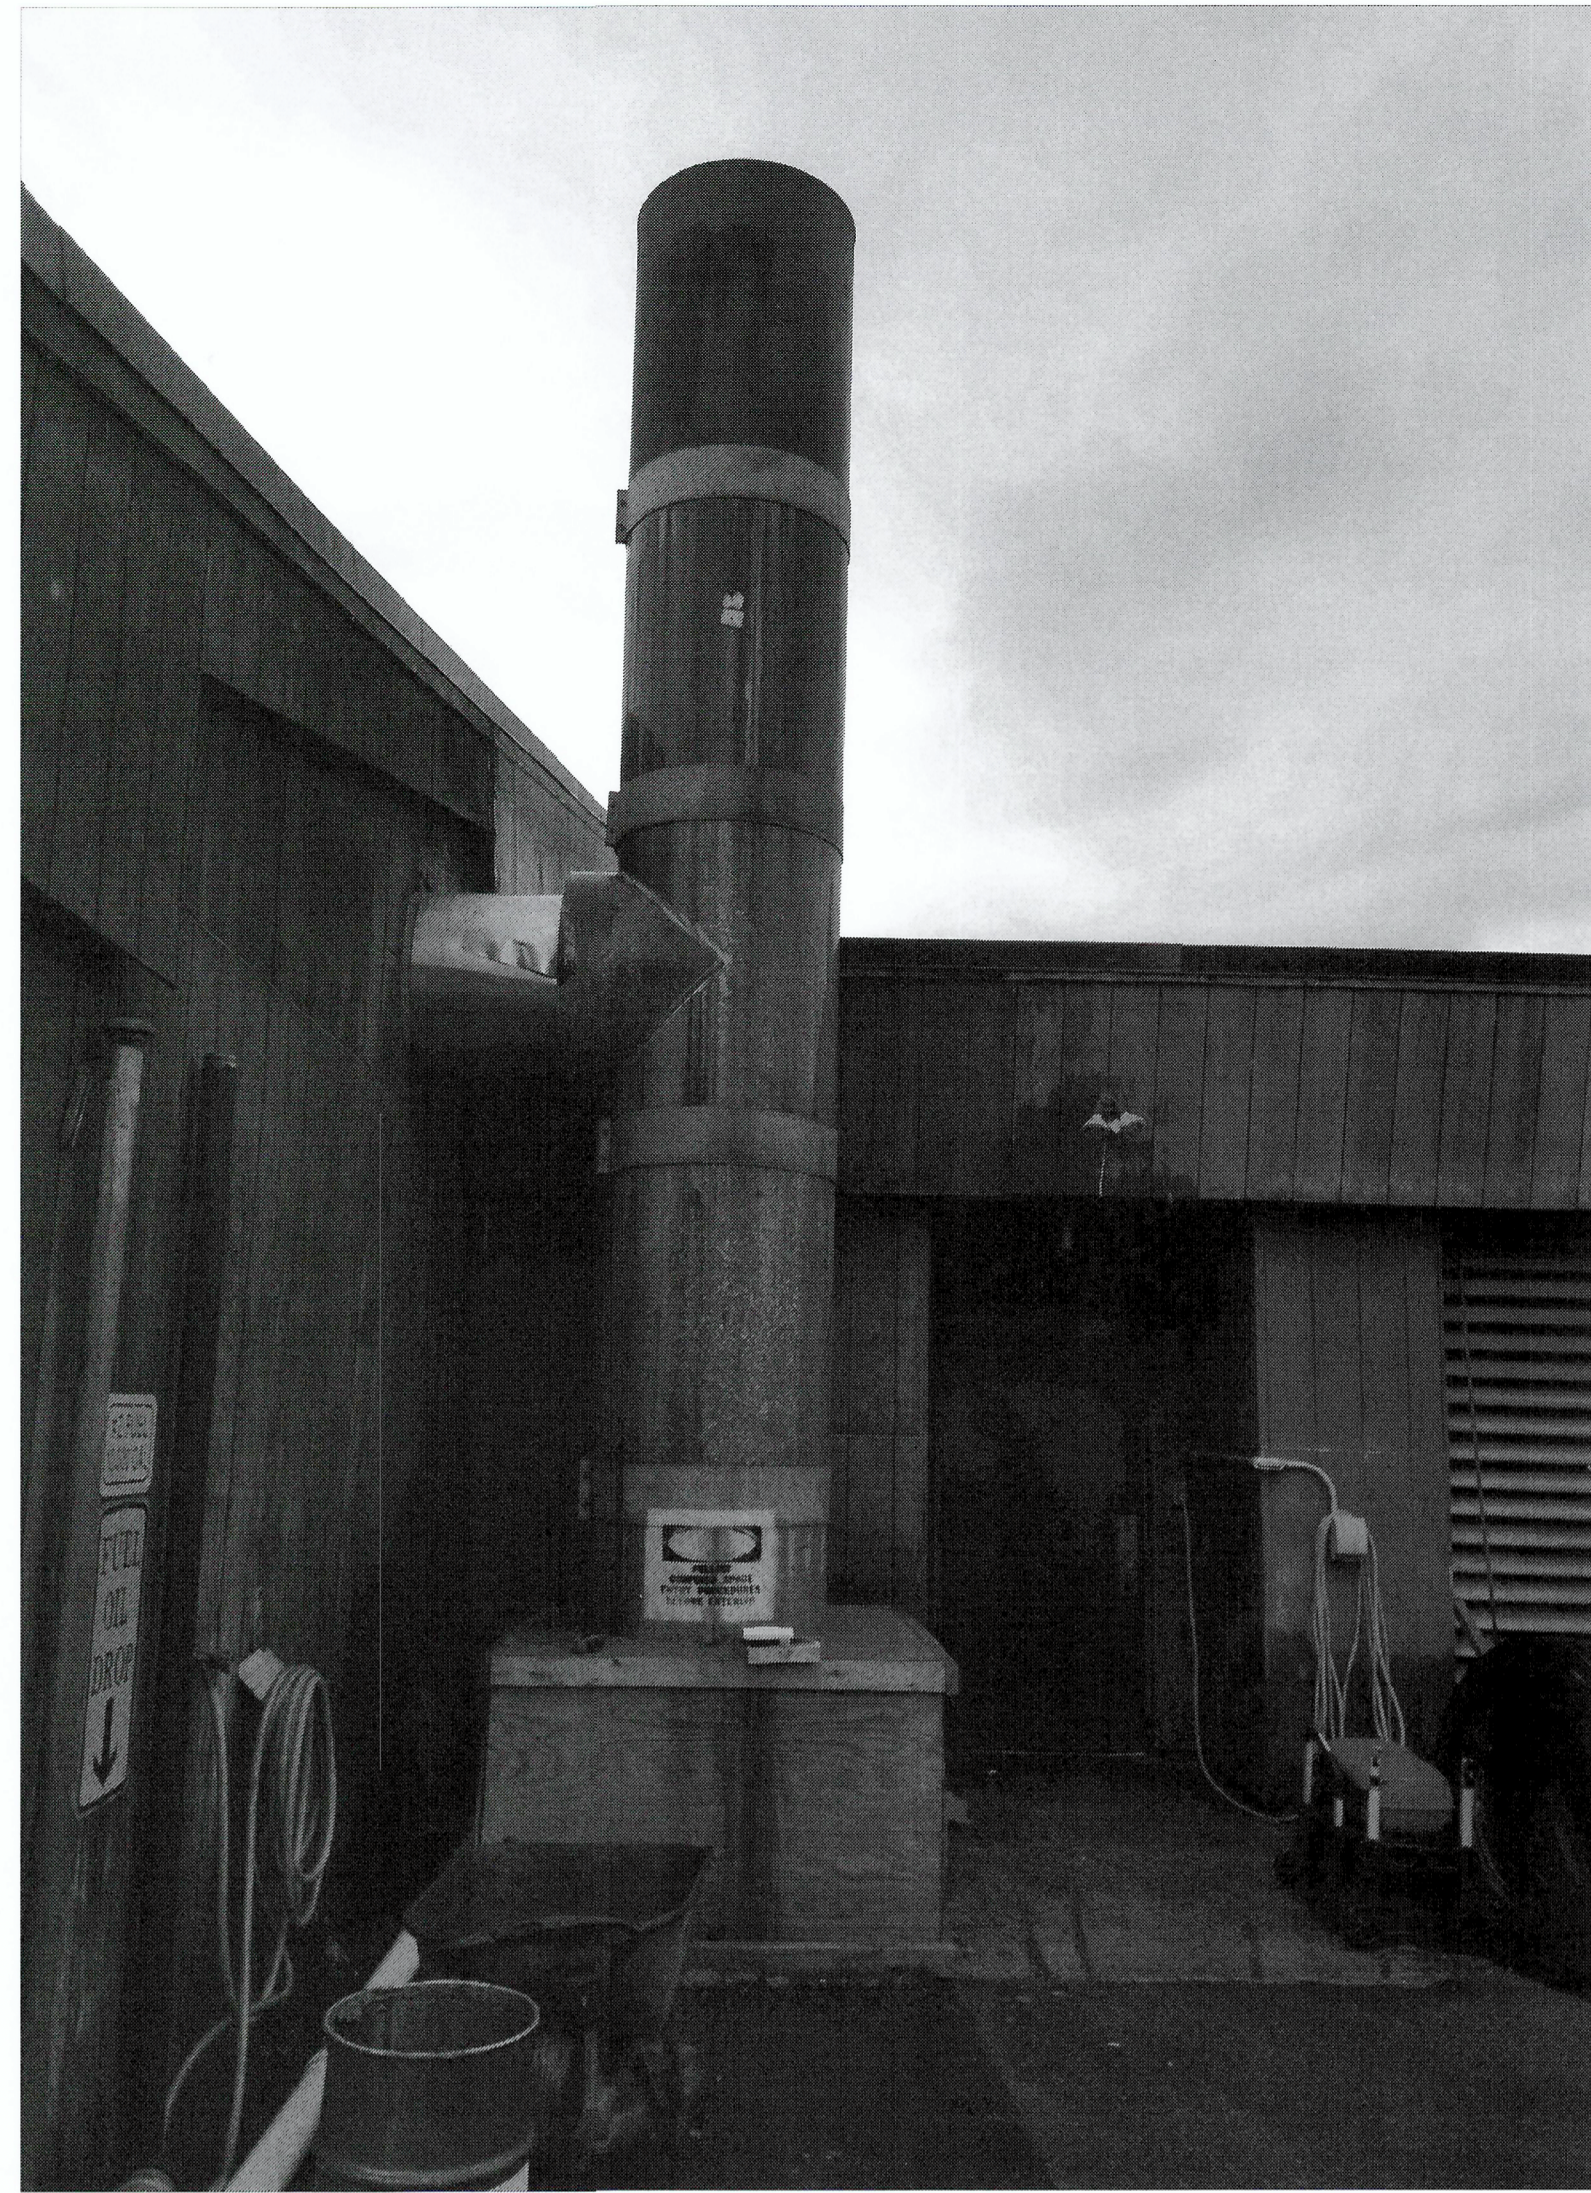

PROJECT NORTH



MECHANICAL DEMOLITION PLAN

SCALE: 1/8" = 1'-0"

AES
NORTHEAST

Architecture, Engineering, and Land Surveying Northeast, PLLC
10-12 City Hall Place, Plattsburgh, NY 12901
Phone: (518) 561-1588 www.aesnortheast.com
© Copyright 2018 AES Northeast, PLLC. All Rights Reserved.

Note: It is a violation of law for any person, unless they are acting under the direction of a licensed Professional Engineer, Architect, Landscape Architect, or Land Surveyor, to alter an item in any way. If an item bearing the stamp of a licensed professional is altered, the altering Engineer, Architect, Landscape Architect, or Land Surveyor shall stamp the document and include the notation "altered by" followed by their signature, the date of such alteration, and a specific description of the alteration.



GENERAL NOTES:

1. BOILER BLR-1: WEIL-MCLAIN MODEL 88, SERIES 2, MODEL 788 (7 SECTION) 14.2 GPH OIL, 1311 MBH NET, STEAM
2. BOILER BLR-2: WEIL-MCLAIN MODEL 88, MODEL 1088 (10 SECTION) 21.5 GPH OIL, 1904 MBH NET, STEAM
3. OWNER HAS TESTED BUILDING & BREACHING ELEMENTS RELATED TO THIS PROJECT AND RESULTS ARE NEGATIVE FOR ACM. OWNER CAN PROVIDE TESTING REPORTS UPON REQUEST.

DRAWING NOTES:

- 1 REMOVE AND DISPOSE OF EXISTING BREACHING/CHIMNEY AND ASSOCIATED ACCESSORIES. CONCRETE SUPPORT BASE TO BE REMOVED BY OWNER.
- 2 REMOVE AND DISPOSE OF 18" Ø BREACHING HEADER AND INSULATION JACKET.
- 3 REMOVE BAROMETRIC RELIEF DAMPER.
- 4 REMOVE AND DISPOSE OF EXISTING 12" Ø BOILER BREACHING AND INSULATION JACKET.
- 5 DOMESTIC OIL FIRED WATER HEATER TO BE REMOVED BY OWNER.
- 6 REMOVE WATER HEATER BREACHING, INSULATION JACKET, HANGERS, AND SUPPORTS.
- 7 REMOVE AND DISPOSE OF EXISTING 14" Ø BOILER BREACHING AND INSULATION JACKET.
- 8 OWNER TO PROVIDE REMOVAL OF EXISTING WALL FOR NEW BREACHING PENETRATION.
- 9 REMOVE AND DISPOSE OF EXISTING WATER HEATER BREACHING, HANGERS & SUPPORTS.
- 10 PRESSURE WASHER WATER HEATER TO BE REMOVED BY OWNER.

PROJECT TITLE:
ESSEX COUNTY
DEPARTMENT OF PUBLIC WORKS
**BOILER BREACHING
REPLACEMENT**

8053 U.S. 9, ELIZABETHTOWN, NEW YORK, 12932

DRAWING TITLE:
**MECHANICAL
DEMOLITION PLAN**

DWG. ISSUE/REVISIONS	DATE (MM/DD/YYYY)
1. RELEASED FOR BID	7/11/2018

DESIGNED BY: TPC	DRAWN BY: TPC	AES PROJ. NO.: 4673
---------------------	------------------	------------------------

BUILDING ID:	DRAWING NO.: M-101
--------------	------------------------------